



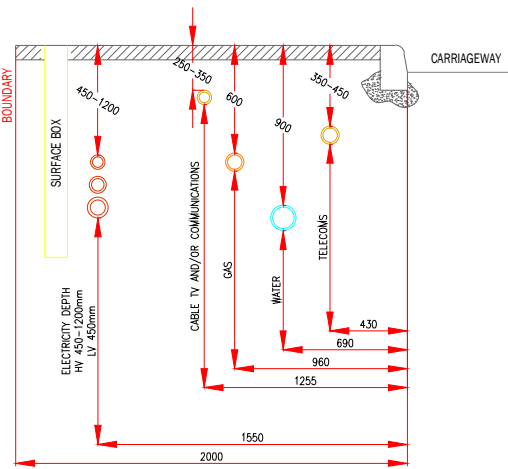

TYPICAL SERVICES UNDER
PAVEMENT TO JVG V1
FIGURE 1
(N758A1)


FIRE HYDRANT DESIGN & INSTALLATION IS TO BE UNDERTAKEN BY SPECIALIST. FINAL DESIGN TO BE CONFIRMED

EXTERNAL LIGHTING DESIGN UNDERTAKEN BY HOLOPHANE. PLEASE REFER TO DRAWING P194-130-DG1 FOR FURTHER DETAIL OF LUMINAIRES

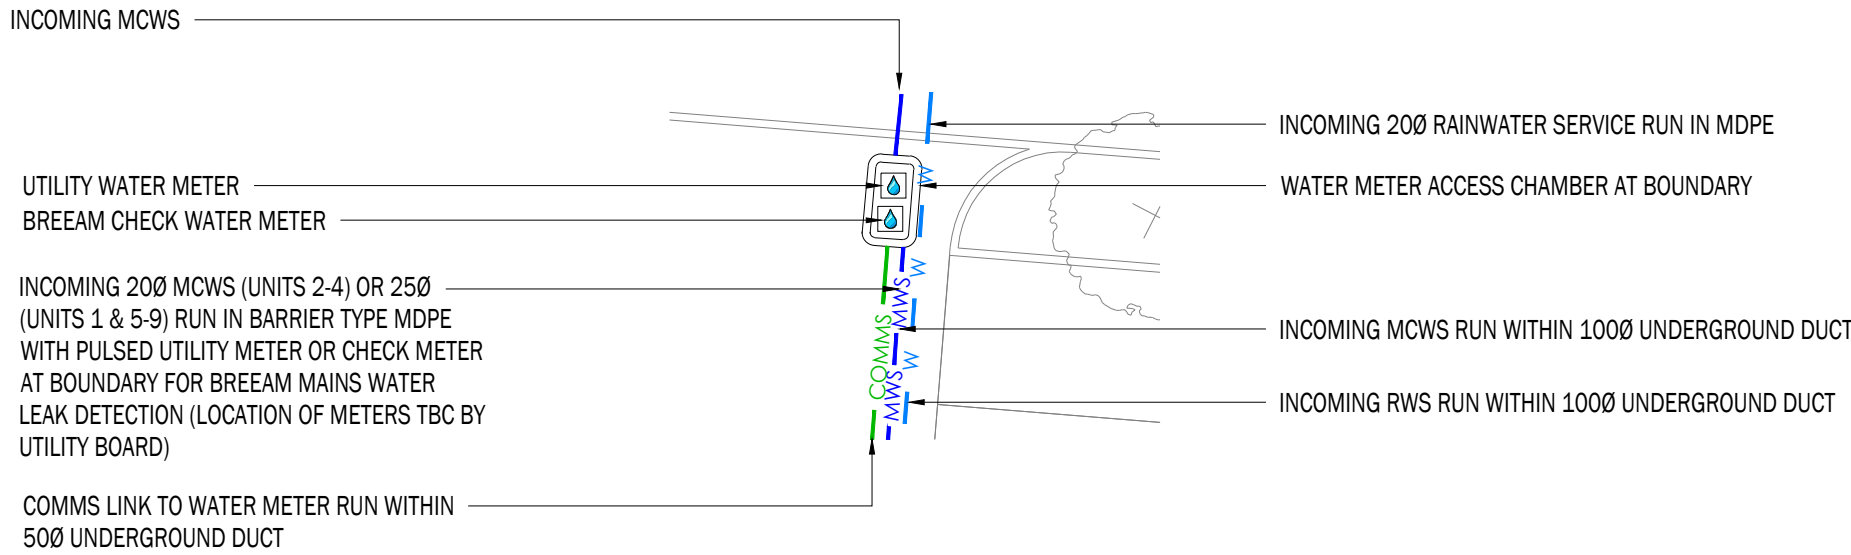

DT DETAIL A

NTS @ A1

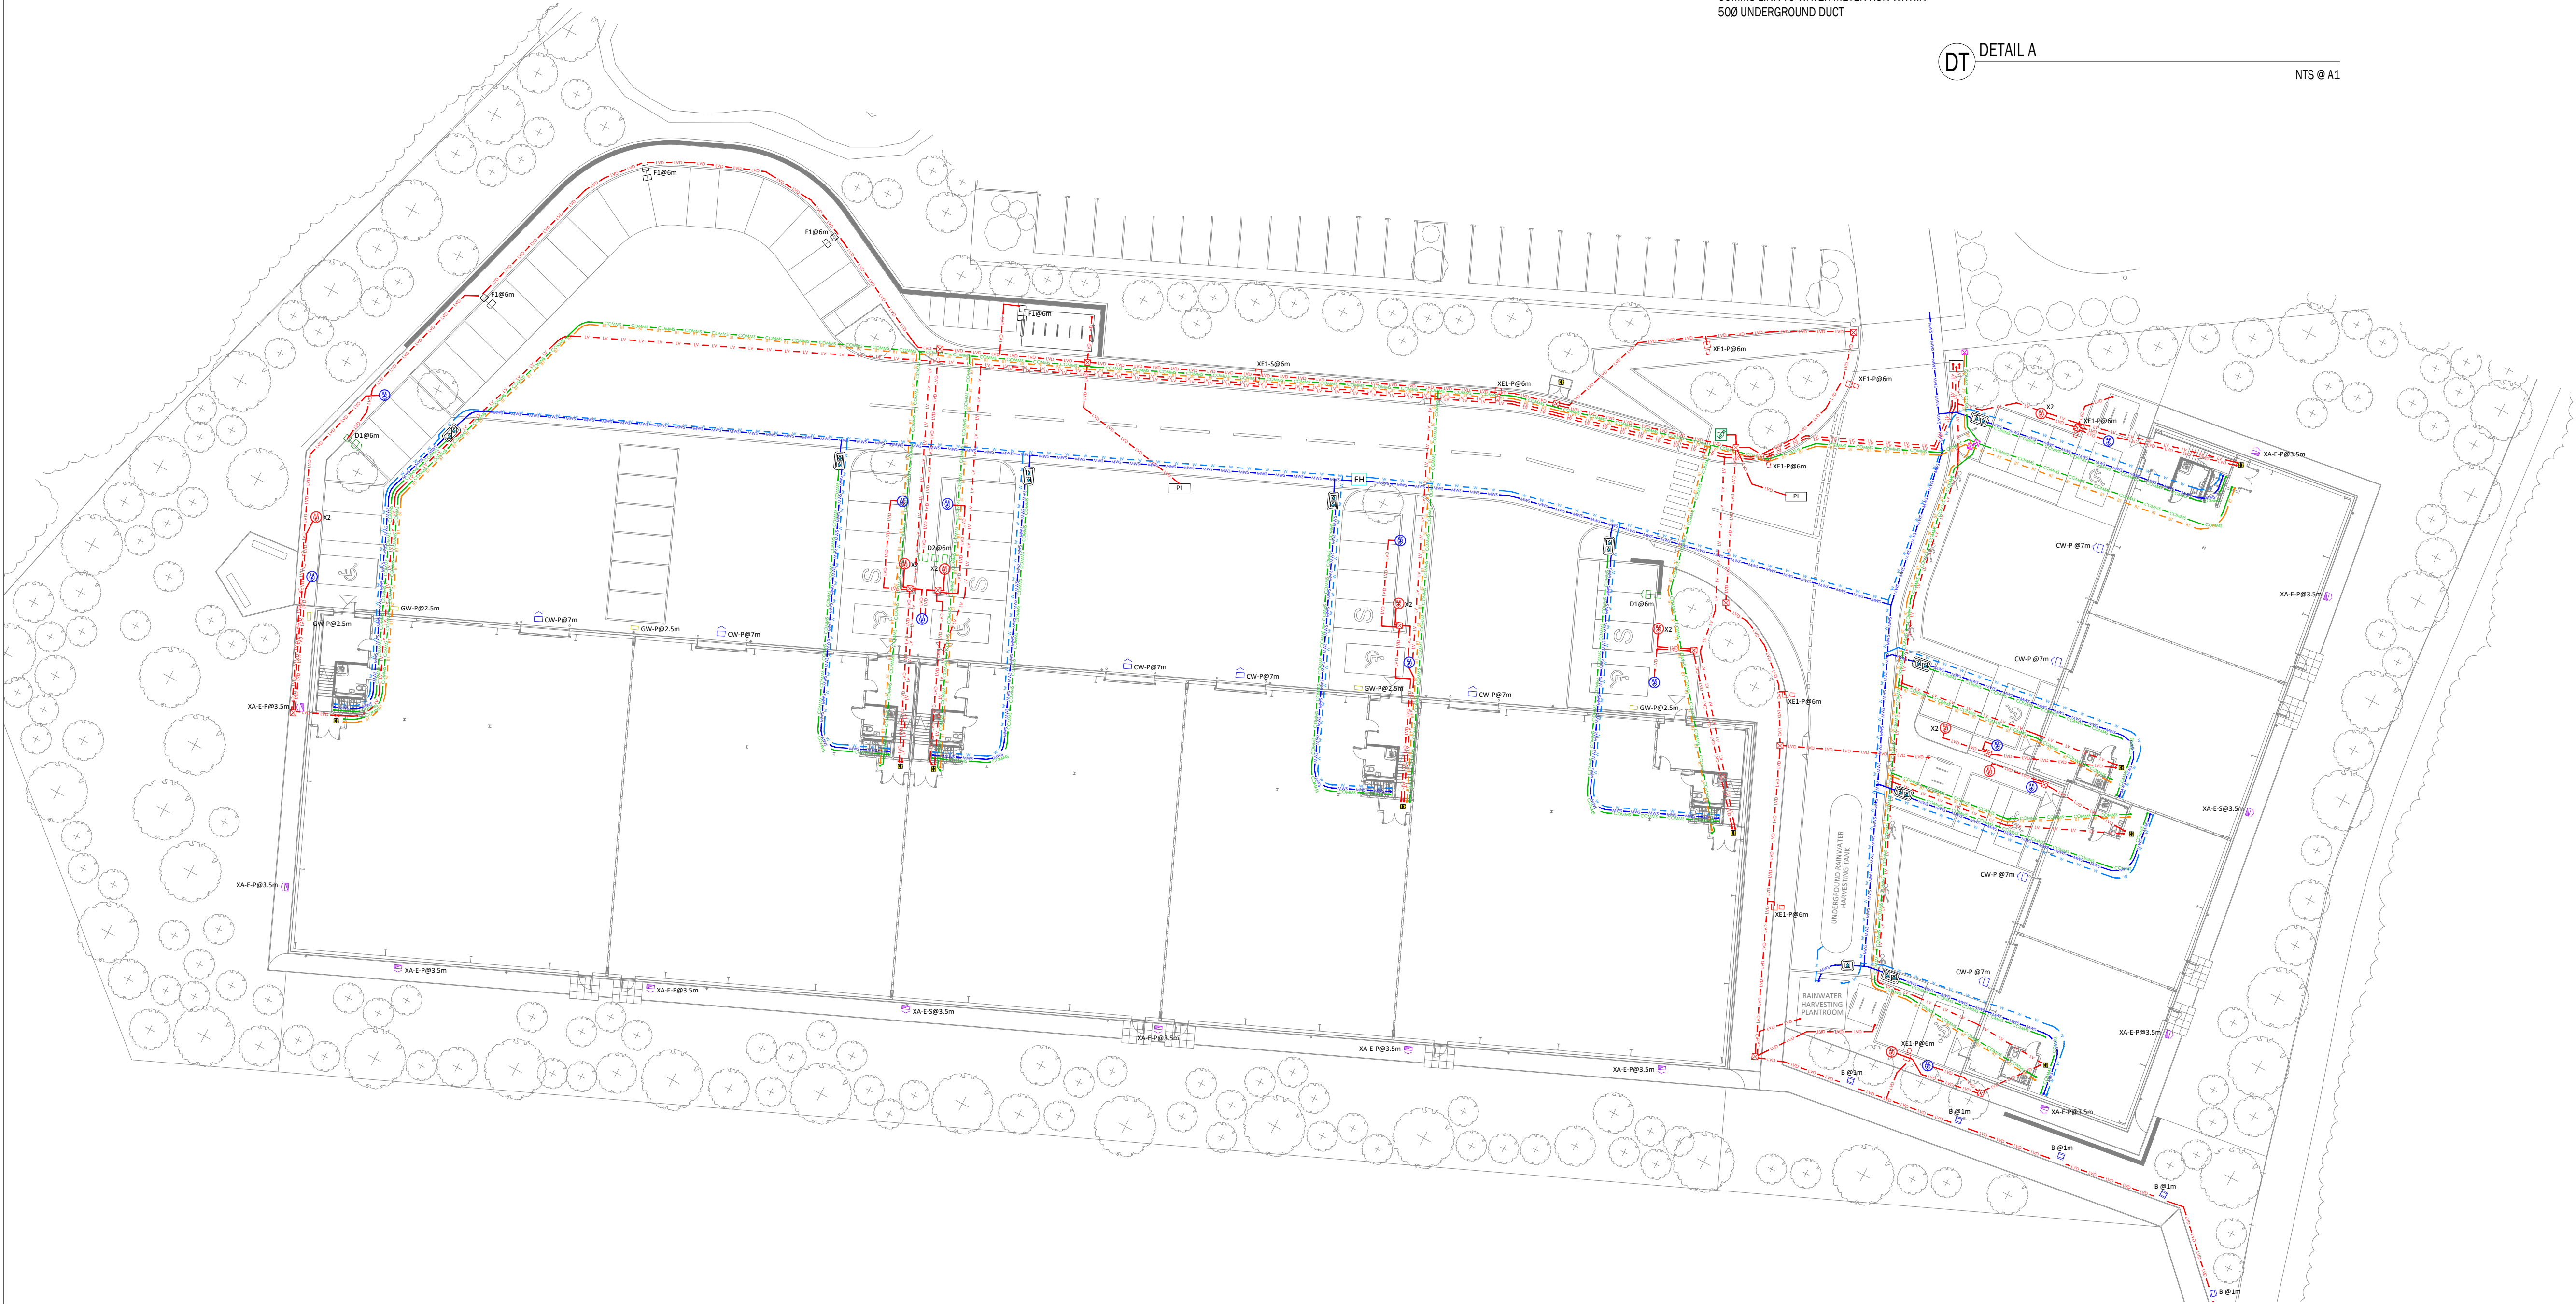

GENERAL NOTES:

- THESE DRAWINGS MUST NOT BE MODIFIED OTHER THAN BY MNE BUILDING SERVICES LTD AND ARE COPYRIGHT OF MNE BUILDING SERVICES LTD. PLEASE OBTAIN PERMISSION BEFORE COPYING OR SHARING.
- CONTRACTOR AND ALL SUB-CONTRACTORS SHALL FAMILIARISE THEMSELVES WITH EXISTING CONDITIONS, PROJECT REQUIREMENTS, DRAWINGS AND SPECIFICATIONS PRIOR TO UNDERTAKING WORKS.
- DO NOT SCALE FROM THESE DRAWINGS.
- FOR SETTING OUT INFORMATION REFER TO ARCHITECTS DETAILS WHERE APPROPRIATE.
- PLEASE CONTACT MNE BUILDING SERVICES LTD IN THE EVENT OF DISCREPANCIES ON DRAWING.

LEGEND

- CABLE DRAW PIT
- OPENREACH CABLE PIT
- COMMS PIT
- UTILITY ELECTRICITY METER
- UTILITY WATER METER
- FIRE HYDRANT
- PETROL INTERCEPTOR
- FUTURE ELECTRIC VEHICLE CHARGING POST
- SINGLE 7kW ELECTRIC VEHICLE CHARGING POST
- DOUBLE SIDED 7kW ELECTRIC VEHICLE CHARGING POST
- DEFIBRILLATOR CABINET

LINE - TYPES:

- SPARE COMMS DUCTS (1000)
- MAINS WATER RUN IN BARRIER PIPE MDPE
- BT / OPENREACH DUCTS (DUCTS TO OPENREACH SPECIFICATION)
- INCOMING LV CABLEING / DUCTING (TO APPOINTED DNO SPECIFICATION)
- LV DUCTS (1000 & 1500)
- RAINWATER HARVESTING PIPEWORK RUN IN MDPE

P1	PRELIMINARY ISSUE -	05.12.25
REVISION	DESCRIPTION	DATE

PRELIMINARY

CLIENT



PROJECT NAME

BILLINGSHURST

DRAWING TITLE

EXTERNAL SERVICES
SITEWIDE

DRAWING REFERENCE

25877-IDC-ZZ-00-DR-SIP-MEP-9601 - Sitewide

DATE:	NOVEMBER '25	SCALE:	1:300 @ A1
DRAWN:	PS	CHECKED:	T0
		AUTH:	JB

MNE Building Services Ltd



UNIT 4H
THE OAST BUSINESS CENTRE
62 BELL ROAD
SITTINGBOURNE
KENT, ME10 4HE

01795 889 462
mail@mne-bs.co.uk
https://mne-bs.co.uk/